


# HAULED WATER STORAGE SYSTEM

Approval must be obtained from the local health department prior to the installation/construction of any hauled water storage system.

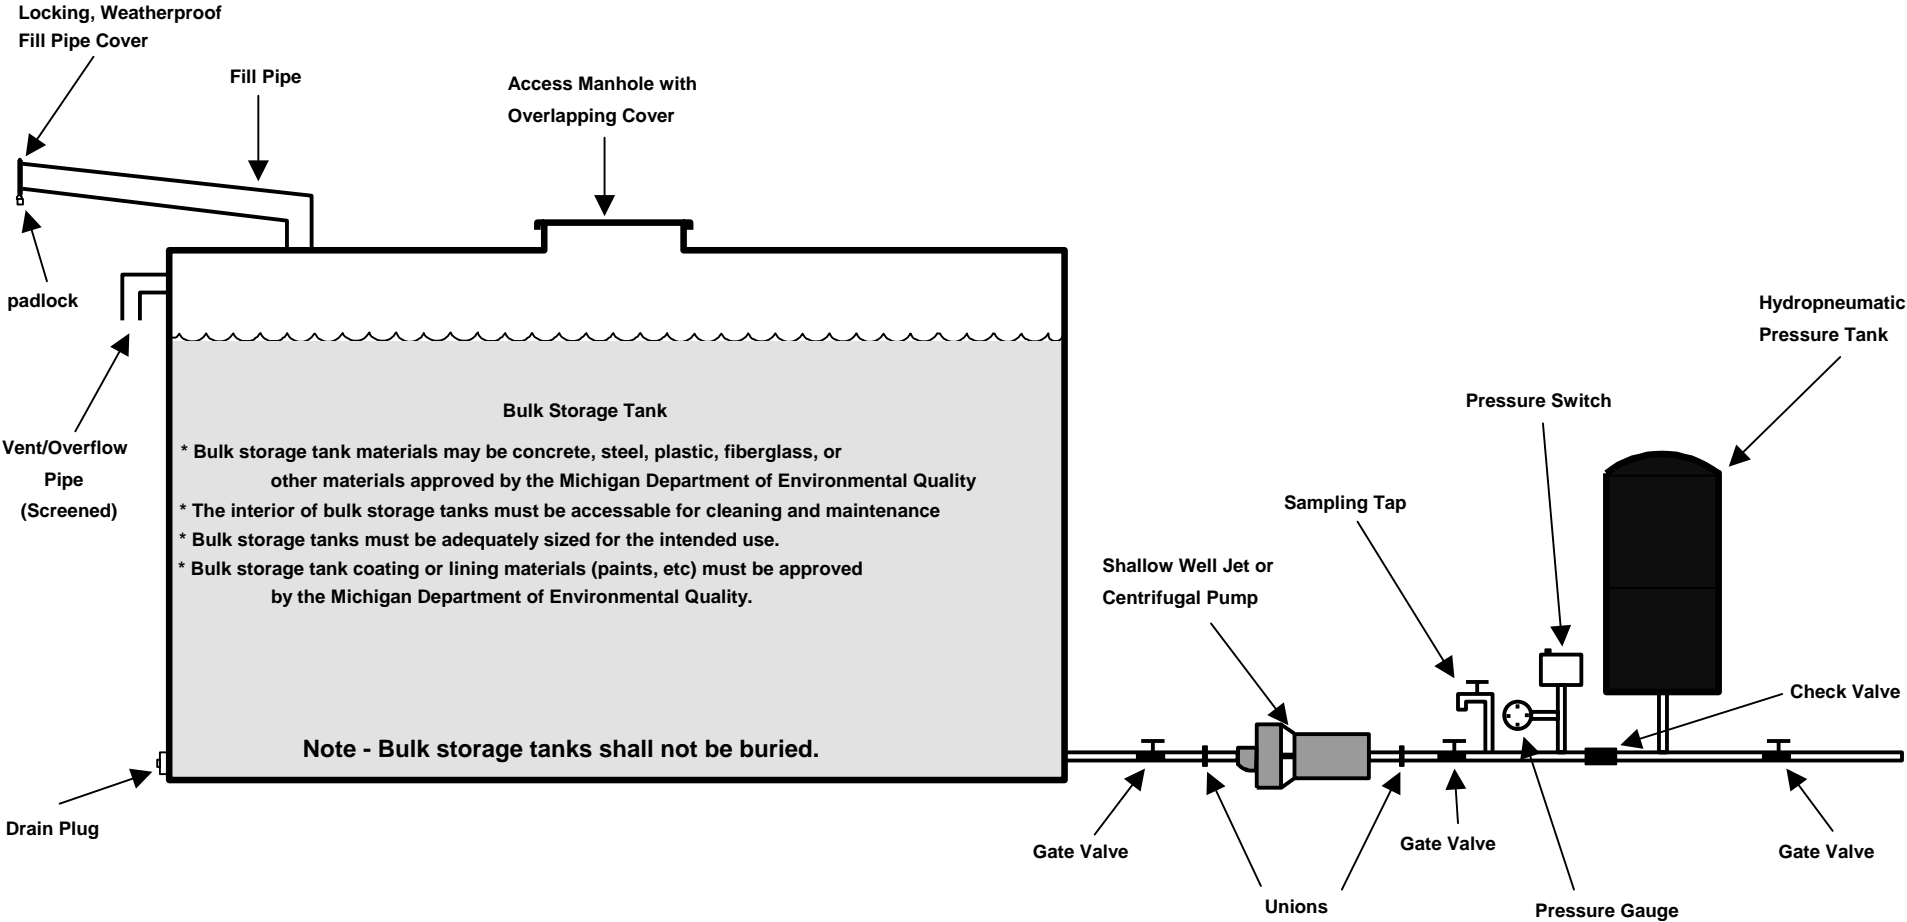

\* All plastic piping materials must be NSF approved for potable water.  
 \* Piping materials must be copper, galvanized, plastic, or other materials approved by the Michigan Plumbing Code.