


SECTION A-A

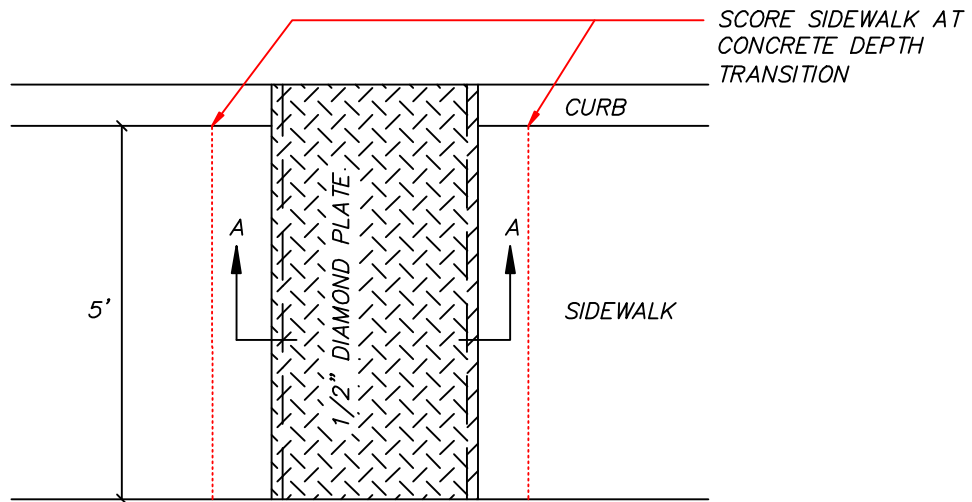

PLAN

NOTES:

1. CONCRETE SHALL MEET THE REQUIREMENTS OF SECTION 337.10 OF THE LATEST EDITION OF THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION.
2. AGGREGATE BASE MATERIAL SHALL MEET THE REQUIREMENTS OF SECTION 302 & 308 OF THE LATEST EDITION OF THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION.
3. USE 3/4" DIAMOND PLATE WHEN THE SIDEWALK OPENING WIDTH EXCEEDS 18".

NO.	REVISION	DATE	STANDARD DETAILS FOR PUBLIC WORKS CONSTRUCTION	SECTION DRAINAGE
			SIDEWALK CROSS-DRAIN TYPE 1	DRAWING NO. D-3.1
			CITY OF ELKO, NEVADA	DATE 11/30/07
				PAGE 1