


TYPE 1 CURB & GUTTER

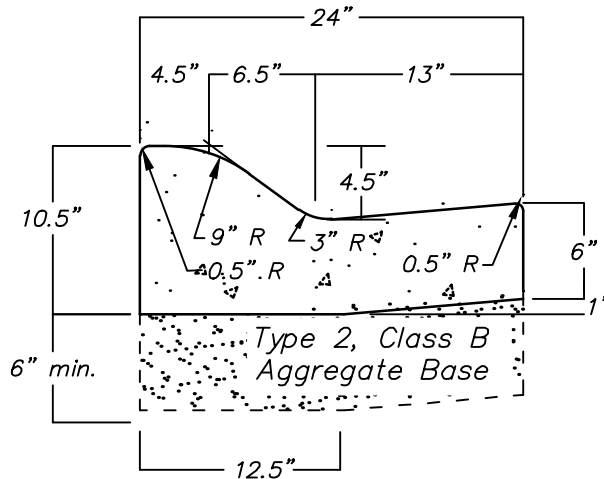

TYPE 2 CURB & GUTTER

NOTES:

1. CONCRETE SHALL MEET THE REQUIREMENTS OF SECTION 337.10 OF THE LATEST EDITION OF THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION.
2. AGGREGATE BASE MATERIAL SHALL MEET THE REQUIREMENTS OF SECTIONS 302 & 308 OF THE LATEST EDITION OF THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION.
3. ALL CONCRETE CURB AND GUTTER SHALL HAVE $\frac{1}{2}$ " EXPANSION JOINTS EVERY 90 FEET AND AT ALL CURB RETURNS. WEAKENED PLANE JOINTS SHALL BE EVERY 10 FEET.
4. PLANTMIX BITUMINOUS SURFACE SHALL BE $\frac{1}{4}$ " TO $\frac{1}{2}$ " ABOVE LIP OF GUTTER PAN.

NO.	REVISION	DATE	STANDARD DETAILS FOR PUBLIC WORKS CONSTRUCTION	SECTION ROADWAY
1	4.5" - TYPE 2	8/21/19	TYPE 1 & 2 CURB & GUTTER	DRAWING NO. R-2.1
			CITY OF ELKO, NEVADA	DATE 8/23/2019
				PAGE 1